


**ELEVATION**


**NOTES:**

1. SEE PLANS FOR NUMBER OF BARRICADES TO BE USED.
2. THE EXACT LOCATION OF BARRICADES MAY BE CHANGED IN THE FIELD BY THE ENGINEER.
3. THE STEEL PIPE ABOVE GROUND SHALL BE PAINTED A MINIMUM OF TWO FIELD COATS OF APPROVED PRIMER.
4. TWO FINISH COATS OF THE DEPARTMENT'S STANDARD YELLOW SHALL BE USED FOR FIRE HYDRANT BARRICADES.
5. BARRICADES FOR BLOW-OFFS, AIR RELEASE VALVES & VAULT VENTS SHALL BE GIVEN TWO FINISH COATS OF YELLOW PAINT.

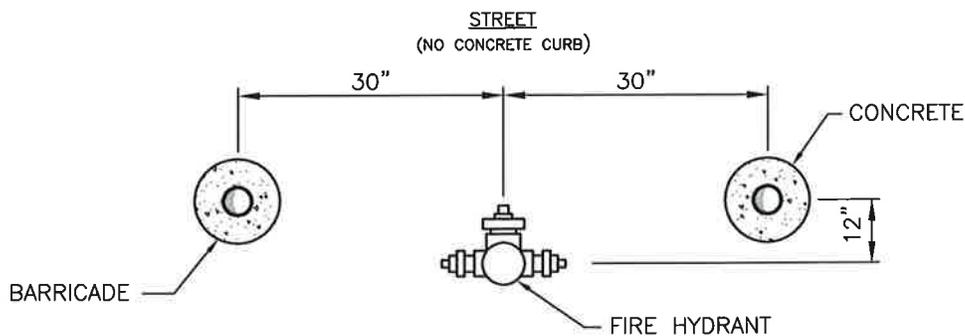

**PLAN  
FIRE HYDRANT BARRICADES  
(TYPICAL)**

REVISION DATE: 9/30/2013

		SAN BERNARDINO MUNICIPAL WATER DEPARTMENT		DRAWING NUMBER
		<b>PERMANENT PIPE BARRICADE</b>		SBMWWD
F.D.L.	SEP. 13			W6.37A
REVISION	DATE	APPROVED	DATE	
SCALE:	NONE	 MATTHEW H. LITCHFIELD, P.E. RCE 58079		10/1/13