
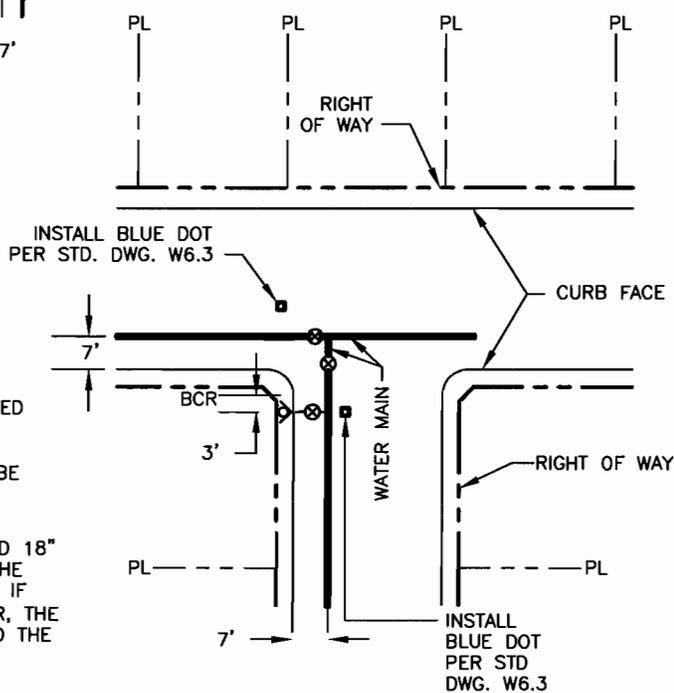


DOMESTIC METER BOX TO BE LOCATED NO CLOSER THAN 3' (EDGE TO EDGE) TO AN ADJACENT DOMESTIC SERVICE.



- NOTES:**
1. WATER MAINS SHALL BE LOCATED ON THE SOUTH OR WEST SIDE OF STREET, 7' FROM CURB FACE. MINIMUM COVER SHALL BE 36" FROM FINISH SURFACE TO TOP OF PIPE.
  2. FIRE HYDRANTS TO BE LOCATED 18" BEHIND CURB FACE AND ON THE PROJECTION OF THE LOT LINE. IF THERE IS LESS THAN 3' CLEAR, THE HYDRANT MUST BE SET BEHIND THE SIDEWALK IN THE PARKWAY.

REVISION DATE: 12/16/2010

		SAN BERNARDINO MUNICIPAL WATER DEPARTMENT		DRAWING NUMBER
F.D.L.	DEC. 10	<b>TYPICAL PIPE and FIRE HYDRANT LAYOUT</b>		SBMWD
M.H.L.	FEB. 04			W2.1
S.W.L.	JAN. 04			
REVISION	DATE			
SCALE: NONE		APPROVED		DATE 10/11/10
		MATTHEW H. LITCHFIELD, P.E. RCE 58079		