
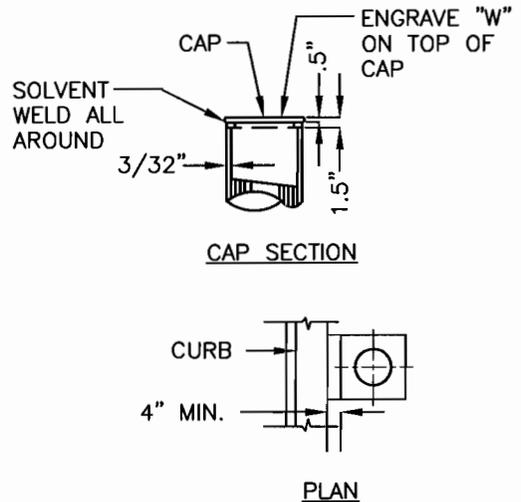
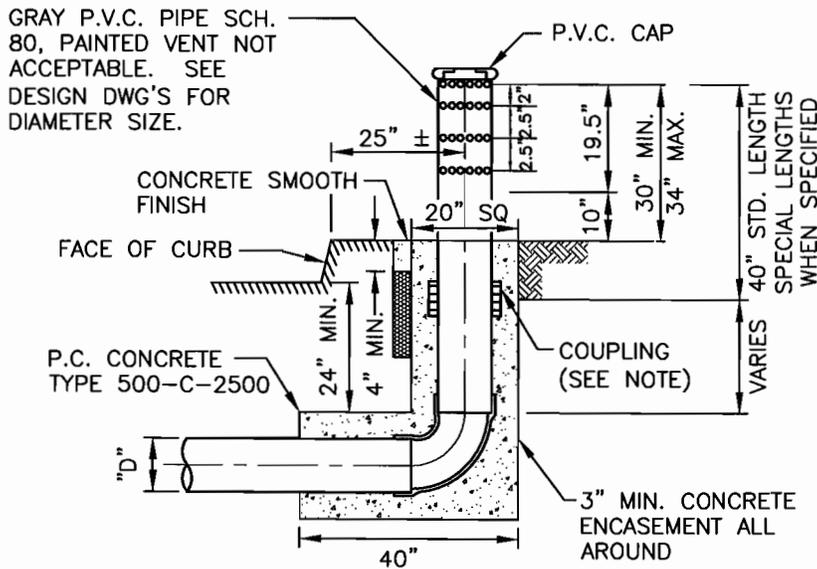


VENT HOLE SPECIFICATIONS

STANDPIPE DIA. - "D"	SPACING DESCRIPTION
6"	8 ROWS OF 9 EQUALLY SPACED 1" HOLES (72 HOLES TOTAL)
8"	8 ROWS OF 12 EQUALLY SPACED 1" HOLES (96 HOLES TOTAL)
10"	8 ROWS OF 17 EQUALLY SPACED 1" HOLES (136 HOLES TOTAL)
12"	8 ROWS OF 20 EQUALLY SPACED 1" HOLES (160 HOLES TOTAL)

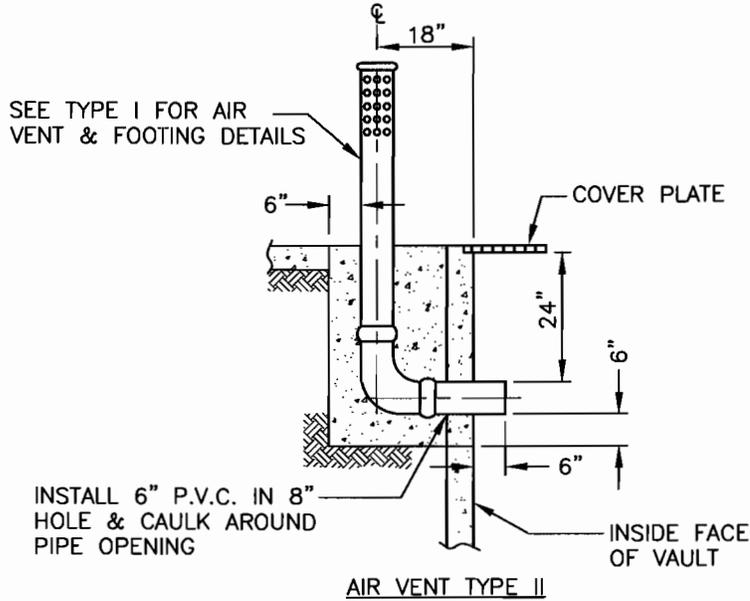

INLET OR OUTLET AIR VENT TYPE I

NOTES:

1. ALL JOINTS ARE TO BE SEALED AGAINST WATER INFILTRATION IN CONFORMANCE WITH CONDUIT MANUFACTURERS RECOMMENDATIONS AND ARE TO BE MADE IN THE PRESENCE OF WATER INSPECTOR (TYPE I OR II).
2. WHERE CURBS AND GRADES ARE NOT ESTABLISHED, BOTTOM HOLES OF VENTS MUST BE 10" MINIMUM ABOVE SURFACE OF THE GROUND (TYPE I ONLY).

REVISION DATE: 3/30/2011

		SAN BERNARDINO MUNICIPAL WATER DEPARTMENT		DRAWING NUMBER
		AIR VENT FOR U.G. STRUCTURES		SBMWD
D.D.M.	MAR. 11			W6.29
M.H.L.	MAR. 05			
REVISION	DATE			
SCALE: NONE		APPROVED: 	DATE: 10/11/11	
		MATTHEW H. LITCHFIELD, P.E. RCE 58079		