
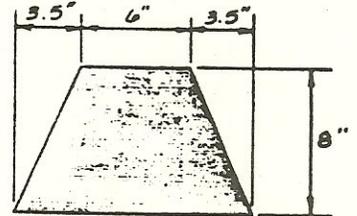
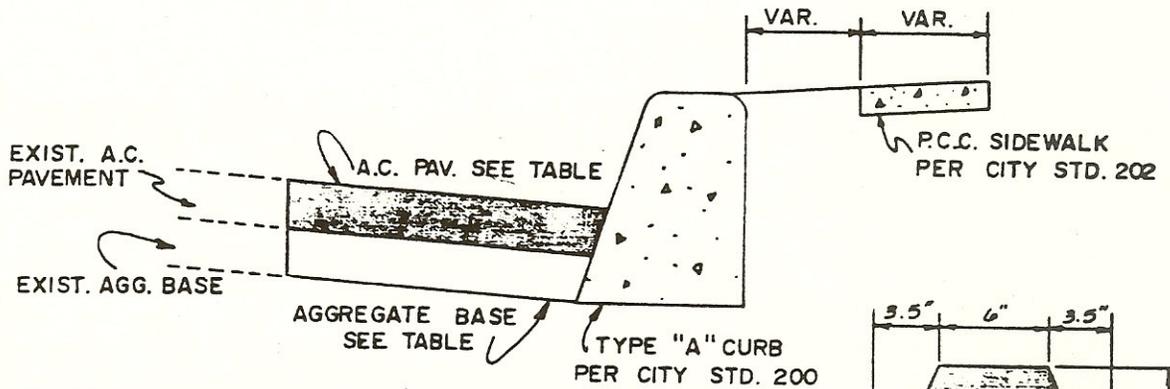


GENERAL NOTES:

1. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, 1982 EDITION, AND STANDARD DRAWINGS ON FILE IN THE OFFICE OF THE DIRECTOR OF PUBLIC WORKS/CITY ENGINEER.
2. PORTLAND CEMENT CONCRETE SHALL BE CLASS 520-C-2500 WITH A MAXIMUM SLUMP OF 4".
3. ASPHALT CONCRETE PAVEMENT SHALL BE CLASS B-AR-4000.
4. AGGREGATE BASE SHALL BE CLASS II.

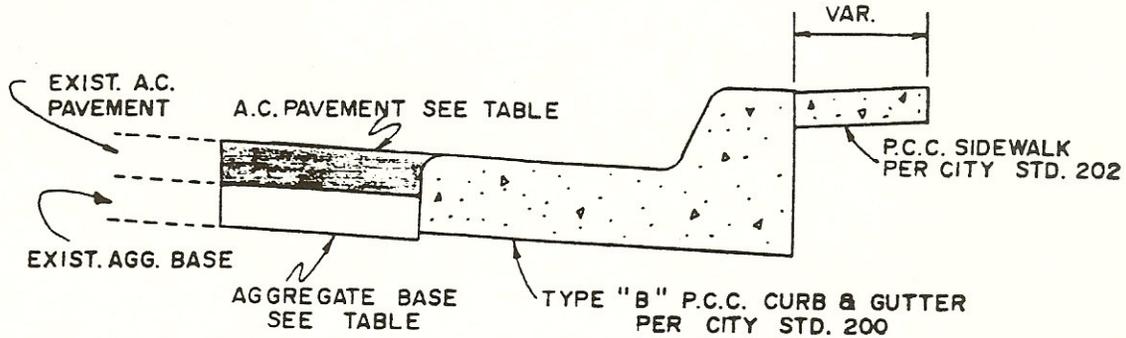

② TYPICAL SECTION
A.C. DIKE

STREET NAME	T.I.	PAVEMENT THICKNESS	AGGREGATE BASE THICKNESS
"I" STREET	7.5	2 1/2"	4"
MILL STREET	9.0	3 1/2"	4"
NINTH STREET	7.5	3"	4"
HIGHLAND AVE.	9.0	4"	6"
FORTIETH ST.	7.5	2 1/2"	4"
① "E" STREET	9.0	3 1/2"	4"
① ARROWHEAD AVE.	9.0	3 1/2"	4"
③ SO. "E" ST.	8.5	3"	4"
④ STODDARD AVE.	4.5	2 1/2"	4"

No.	REVISION	APP.	DATE
②	ADDED SHEET NO. 2		
④	ADDED STODDARD TO P.V.T. TABLE		
③	ADDED SO. E ST. TO P.V.T. TABLE		
②	ADDED A.C. DIKE DETAIL		
①	ADDED "E" ST. & ARROWHEAD AVE TO PAVEMENT THICKNESS TABLE		

CITY OF SAN BERNARDINO - PUBLIC WORKS DEPARTMENT
STANDARDS FOR
CHAPTER 27
IMPROVEMENTS

APPROVED BY:

R. G. ...
DIRECTOR OF PUBLIC WORKS/CITY ENG
ON OCTOBER 4, 19 82

STANDARD DRAWING
NUMBER

103

SHEET 1 OF 2

