


**PLAN**

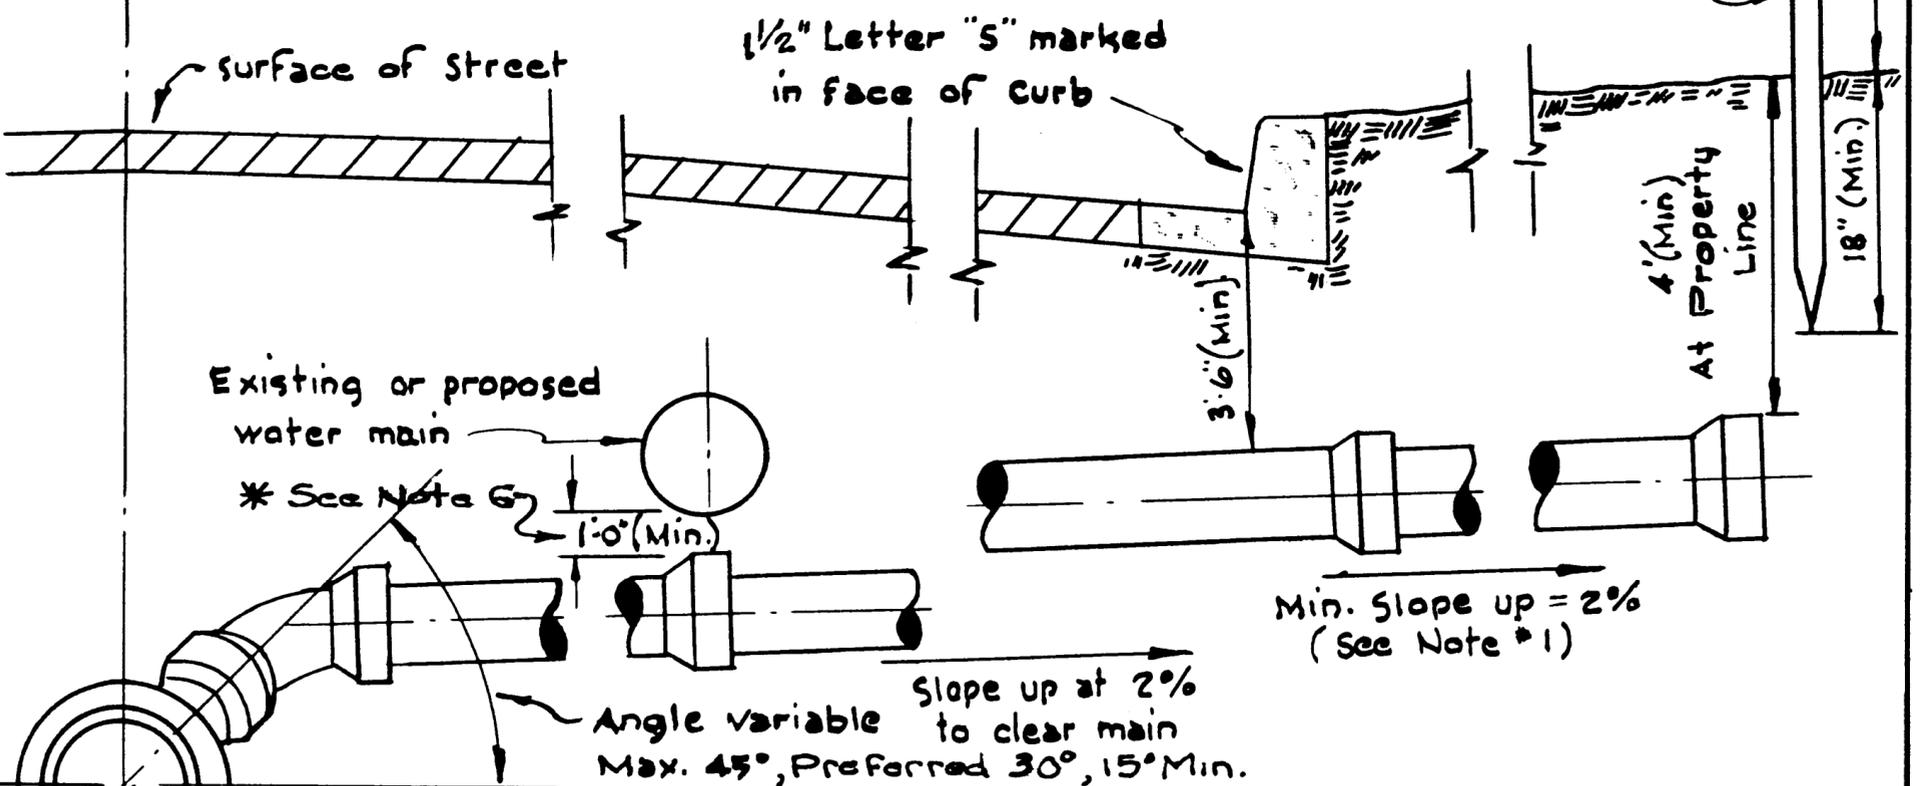

**ELEVATION**

**NOTES:**

- 1 Sewer laterals shall have a minimum slope of 2% except as otherwise specifically noted on the plans.
- 2 Plugs shall be cemented in with cement mortar, or shall be neoprene stopper or approved equal.
- 3 In no case shall a lateral connect to the sewer main directly on top of the pipe.
- 4 Where a standard "Cut in Wye" or Tee is used, it shall be surrounded with 6" of Portland Cement Concrete.
- 5 Laterals shall end at the property line unless otherwise noted on the plans.
- 6 Where clearance is less than 1'-0" Standard Concrete Encasement shall be installed for a distance of 5'-0" on either side of the water main.

REV. 2 Revised Standard No. Appr. *8/21/78* *Oliver & Hartman* REV. Added Note 6 Appr. *12-6-67*

CITY OF SAN BERNARDINO - PUBLIC WORKS DEPT.  
**SEWER LATERAL  
 NORMAL CUT**

APPROVED  
*12-1*, 19*67*  
*P. J. Fisher*  
 CITY ENGINEER

STANDARD  
 No.  
 305